

Metro Tiles - STN Bali Porcelaintech Series NATURAL FINISH 230x1200 - 527775

22 Sep 2016

Report Details

This Report In accordance with Australian Standards	AS 4586 (New) Appendix A
Test Report Number:	KO220916-9
Report Prepared For:	Metro Tiles
Client Billing Address:	192 Granite Street GEEBUNG QLD 4034
Property / Tile Tested:	STN Bali Porcelaintech Series NATURAL FINISH 230x1200
Date Tested:	22 Sep 2016
Testing carried out using the Wet Test Method, using	Slider 55 (TRL) Rubber slider
Pendulum machine in use - Calibration Date	Munro Portable Skid Tester # 1133 - 24.08.2015

Pre Start Checklist

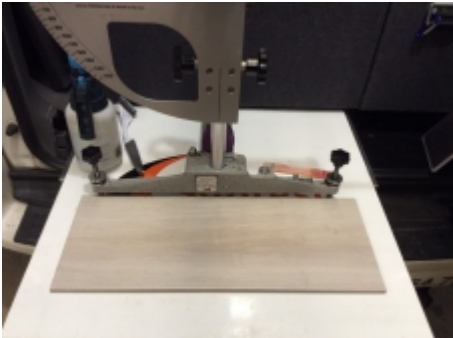
1. Level and Zero Pendulum at start	Checked
2a. Record ambient temperature (°C)	24
Temperature Correction for Type 55 (TRL) Rubber Slider	24-26 = +1
2b. Record weather	Indoors
3. Check weight of slider #96 = 39g ± 2g #55 = 35g ± 2g	34
4. Check slider batch number and expiry date record batch number. Check contact surface slider under 4 millimetre	86
5. Check size of slider. Length = 76.0mm ± 1.0mm Width= 25.4mm ± 1.0mm Thickness = 6.4mm ± 50mm	Checked
6. Slider conditioning value. #96 = 85 ± 10, #55 = 115 ± 10 Slider Contact area 126mm ± 1.0mm (124 ± 1.0mm) using the top of the slider as a guide	112
7. Lapping paper value Last 5 swings (suggested values) #96 = 61 ± 3 #55 = 55 ± 6	54
8. Digital Spirit Level accuracy test (check zero)	Checked
9. Fixed Test	No

The information presented herein and on the Sliptest Report is copyright and is protected by copyright law, any reproduction of this information and test report except in full is prohibited. Any enquiries in relation to this report should be directed to Sliptest Australia Pty. Ltd. quoting the applicable test report number.

Sliptest Australia Pty. Ltd. performed this on site test with reference to the following Australian Standard testing criteria, of AS 4586:2013 Classification of new pedestrian surface materials. Appendix A – Wet Pendulum Test Method and Hand Book HB 198: 2014 with reference to AS/NZS 4663: 2004 Slip Resistance measurement of existing pedestrian surfaces and HB 197: 1999

Test Information

Test Location & Images

Test Location	Grade Degrees	Swing 1	Swing 2	Swing 3	Swing 4	Swing 5	Specimen British Pendulum Number (SRV)	SCV	Photo of Test Site
T1	< 1.5	45	45	44	44	44	44	N/A	
T2	< 1.5	46	45	45	44	44	44	N/A	
T3	< 1.5	42	42	41	41	41	41	N/A	
T4	< 1.5	43	43	42	42	42	42	N/A	
T5	< 1.5	42	42	42	42	42	42	N/A	

Total all Values

213

Mean Sample BPN (SRV)	43
Variation of Standards	N/A

The above classifications are provided without Slope Correction Values

Under AS 4586:2013 (NEW PEDESTRIAN SURFACES) you have Achieved a Average Classification of the following :-

Slider 96 (4S) Achieved a BPN of	N/A
Slider 55 (TRL) Achieved a BPN of	40 - 44 = P4 (W)
Australian Standards Recommend for this area a classification of a	N/A

SA HB 198:2014 - GUIDE TO THE SPECIFICATION AND TESTING OF SLIP RESISTANCE OF PEDESTRIAN SURFACES

SA HB 198:2014	Table 3A - Minimum Wet Pendulum Test or Oil-Wet Inclining Platform Classification that are deemed-to-satisfy the Building Applications in the NCC
	Table 3B - Wet Pendulum Test or Oil-Wet Inclining Platform Classifications for Applications where the NCC does not require Slip Resistance
External Pavement and Ramps	External ramps including sloping driveways, footpaths, etc..under 1:14, external sales areas (e.g Markets), external carpark areas, external colonnades, walkways, pedestrian crossings, balconies, verandas, carports, driveways, courtyards and roof decks = P4 or a R11
Hotels, Offices, Public Buildings, Schools and Kindergartens	WET - Entries and access read including hotels, offices, public buildings, schools, kindergartens, common areas of public buildings, internal lift lobbies = P3 or a R10
Supermarkets and Shopping Centres	N/A
Loading Docks, Commercial Kitchens, Cold Stores, Serving Areas	N/A
Swimming Pool and Sporting Facilities	Swimming Pool surrounds and communal shower rooms = P4 or a B
Hospital and Aged Care Facilities	N/A

Comments

Surface Treatment if Any:	Nil
Zero pendulum at finish (to be completed at end of testing)	Yes
Testing Officer	Kathryn Ording
Testing Officer Signature	

This report and covering documentation was prepared by Sliptest Australia Pty. Ltd. on behalf of our client as named in the report. Neither Sliptest Australia Pty. Ltd. nor any person acting on our behalf (a) makes any warranty, express or implied, with respect to the use of any information or methods disclosed in this report or (b) assumes any liability with respect to the use of any information or methods disclosed in this report or covering information. Any recipient of this document, by their acceptance or use of this document, releases Sliptest Australia Pty. Ltd. and their affiliates from any liability for direct, indirect, consequential or special loss or damage whether arising in contract, warranty, express or implied, tort or otherwise, and irrespective of fault, negligence and strict liability.?